




# 2FT Staircase Installation Guide


## PARAMETER SETTING BY DIP SWITCH

1 & 2 Set sensitivity      3 & 4 Set hold time      5 & 6 Set the lux  
7 & 8 Stand by light level      9 & 10 Set stand by time




## DETECTION RANGE SETTING (SENSITIVITY)

Detection range can be reduced by selecting the combination on the DIP switches to fit precisely each application:

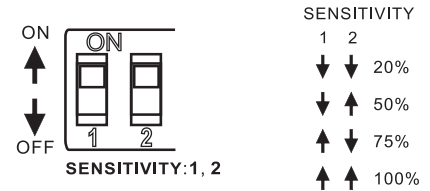


## HOLD TIME SETTING

The lamp can be set to stay ON for any period of time between approx. 10 sec and a maximum of 15min. Any movement detected before this time elapse with re-start the timer. It is recommended to select the shortest time for adjusting the detection zone and for performing the walk test. Switch location and hold time of the corresponding table is as follow:

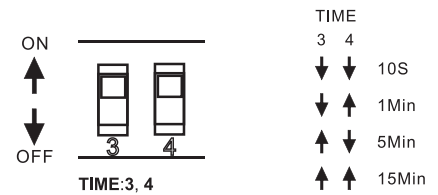


## LIGHT CONTROL SETTING

The chosen lamp response threshold can be infinitely from approx. 10-50 lux, switch location and light-control of the corresponding table is as follow:

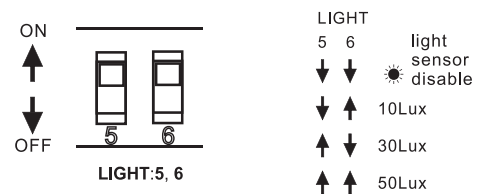


## DETECTION RANGE SETTING

The corresponding file of switch location and stand-by level as follow:

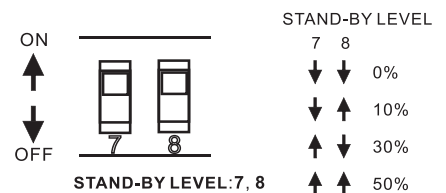

## DETECTION RANGE SETTING

The corresponding file of switch location and stand-by time as follow:

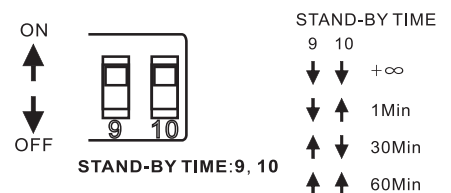

\* Parameter setting by remote control in manual of LB85170-MSR